


Two-pipe One-way Cassette Fan Coil Unit


1. Features	2
2. External Appearance.....	2
3. Products Lineup.....	3
4. Nomenclature	3
5. Specifications.....	4
6. Dimensions.....	5
7. Service Spaces.....	5
8. Wiring Diagrams.....	7
9. Capacity Tables	8
10. Installation	19
11. Troubleshooting	28

1. Features


- ✚ Capacity ranges from 300CFM to 600CFM.
- ✚ One direction air flow guarantees quick cooling, flexible installation positioning.

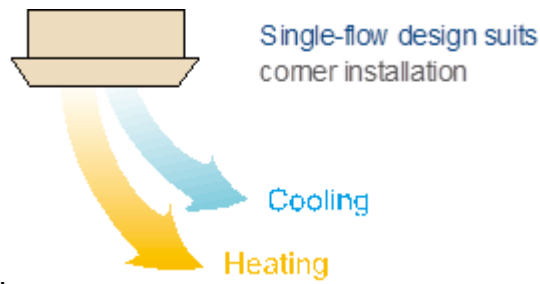

- ✚ Space saving, only 153mm in height.

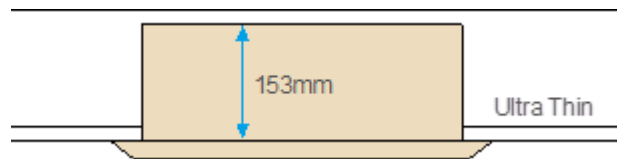

- ✚ Built-in drain pump with 750mm pumping head.

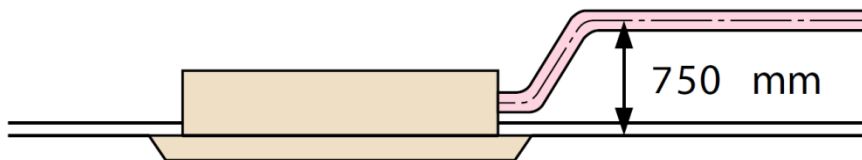

2. External Appearance




3. Products Lineup

Model	Air volume (CFM)	Power supply
MKC-300R-B	300	220~240V-1Ph-50Hz
MKC-300RA-B	300	
MKC-400R-B	400	
MKC-400RA-B	400	
MKC-600HRN4	600	

4. Nomenclature

M K C – 300 R A – B

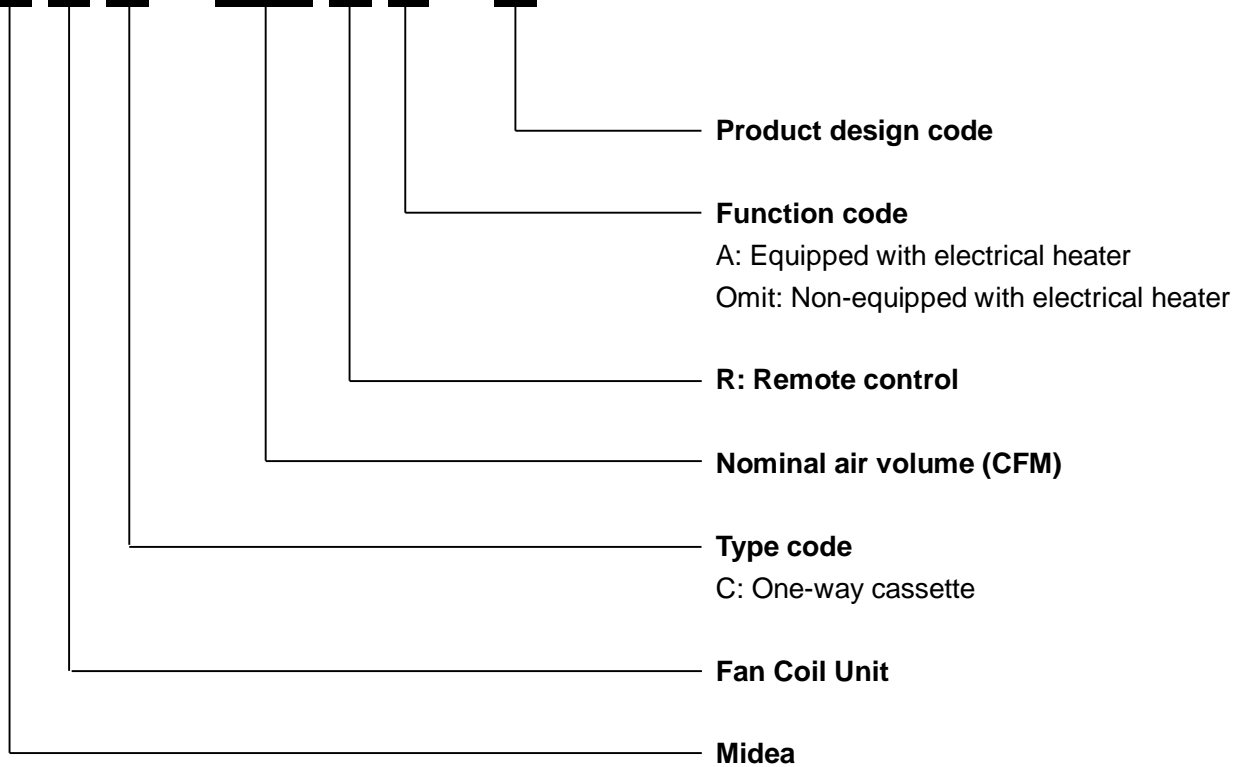


5. Specifications

Model MKC-				300R-B 300RA-B	400R-B 400RA-B	600HRN4
Air flow		H/M/L	m ³ /h	510/450/400	630/560/500	1000/880/800
		H/M/L	CFM	300/270/240	370/330/300	590/520/470
Cooling	Capacity	H/M/L	kW	3.04/2.79/2.56	3.79/3.58/3.38	5.709/4.85/4.36
	Water flow rate	H	L/h	520	650	982
	Water pressure drop	H	kPa	14	20	20.2
Heating	Capacity	H/M/L	kW	5.13/4.69/4.04	6.41/5.86/5.11	9.6/8.36/7.48
	Water pressure drop	H	kPa	9	16	18.1
Power supply			V/Ph/Hz	220-240/1/50		
Power input		H	W	32	40	125
Electric heater capacity			W	750	750	/
Sound pressure level		H/M/L	dB(A)	36/34//32	37/35/34	42/39/37
Fan motor	Type			Low noise 4-speed fan motor		
	Quantity			1		
Fan	Type			Cross fan	Centrifugal fan	
	Quantity			1	4	
Coil	Row			2	3	
	Max. Working pressure		MPa	1.6		
	Diameter		mm	Φ7	Φ8	
Panel	Dimensions	W×H×D	mm	1180x25x465		1420x10x755
	Packing	W×H×D	mm	1232x107x517		1500x110x870
	Net weight		kg	3.5		9
	Gross weight		kg	5.2		12
Body	Dimensions	W×H×D	mm	1054x155x428		1200x198x655
	Net weight	*/A	kg	12.8/13.1		32.6
	Packing	W×H×D	mm	1155x245x490		1380x265x720
	Gross weight	*/A	kg	16.6/17.1		36.3
Pipe connection	Water inlet/outlet pipe		inch	RC1/2		RC1/2
	Drain pipe		mm	ODΦ25		ODΦ25


Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: entering water 7°C, temperature rise 5°C, entering air temperature 27°C DB/19°C WB.
Heating conditions: entering water 50°C, entering air temperature 20°C DB, the same water flow as the cooling conditions.
3. Noise is tested in a semi-anechoic test room.
4. * for models without electric heater, A for models with electric heater.


6. Dimensions

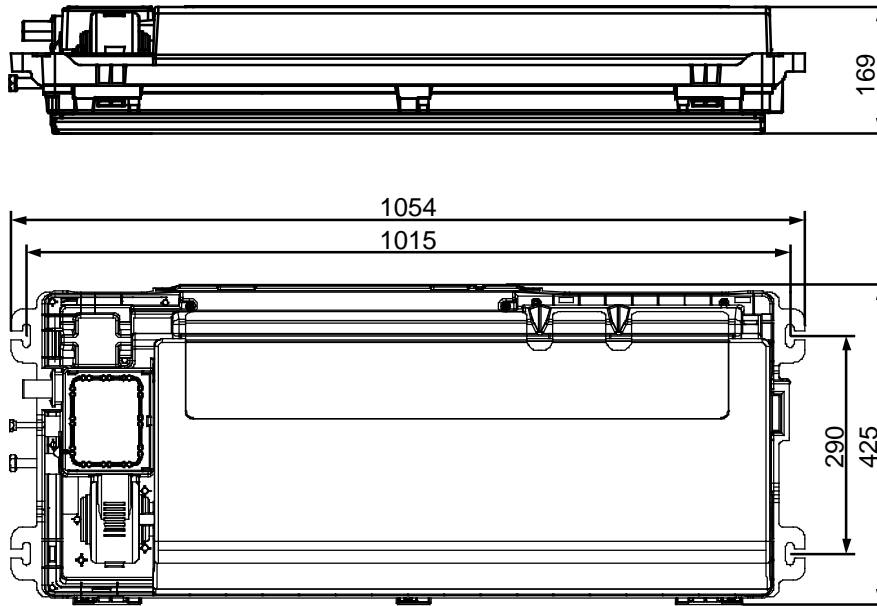

300, 400CFM

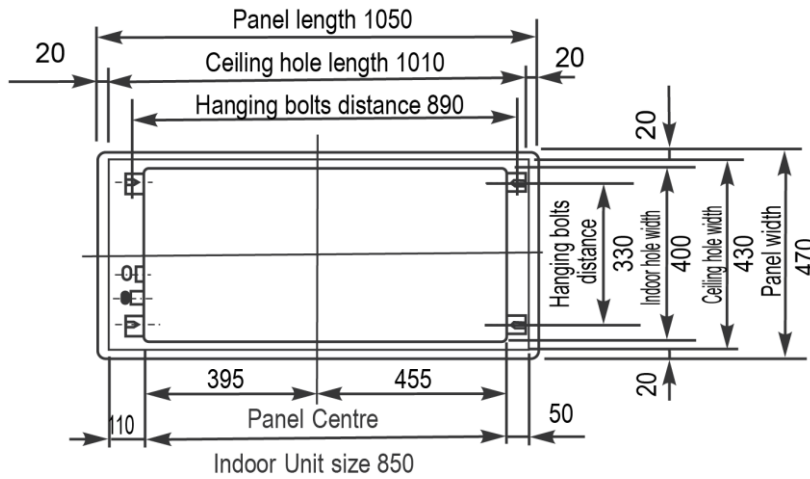



600CFM

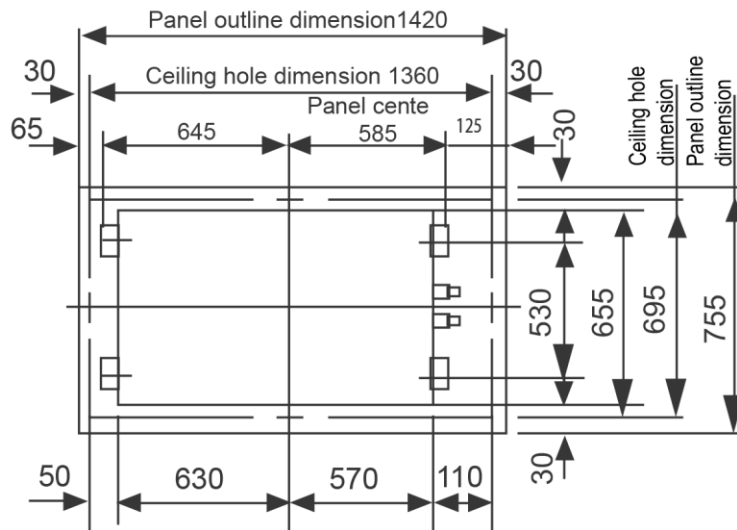

7. Service Spaces

- Please avoid installing in the following places:
 - A place with flammable gas or material.

- A saline place such as seashore vicinity.
- A place with sulfur gas.
- A place with oil gas, such as kitchen.
- A place with high-humidity air.
- An unbearable place.
- A place where high-frequency waves are generated.
- The appliance shall not be installed in the laundry.
- Please comply with the related national electric standard to make electric insulation for construction and metal parts of air-conditioner.
- Please choose the place where the ventilation is good.
- Ceiling space requires 170mm.
- The installation height of the unit cannot be higher than 3.2m, or it will affect the operation effect.

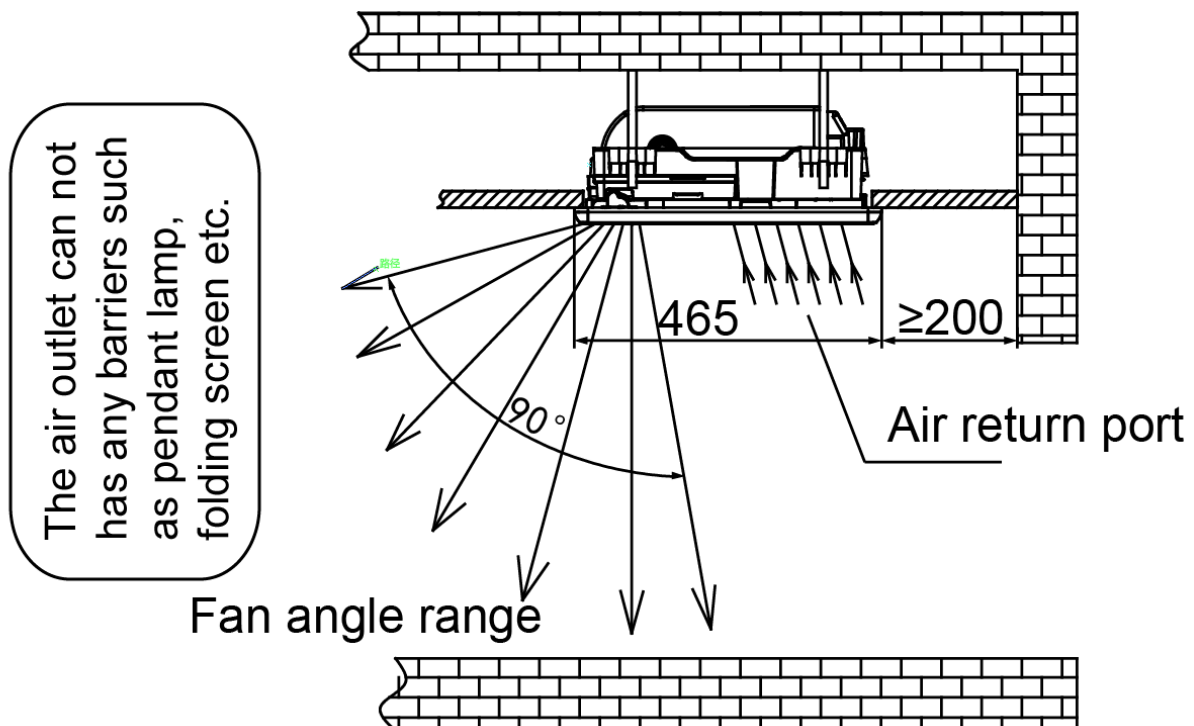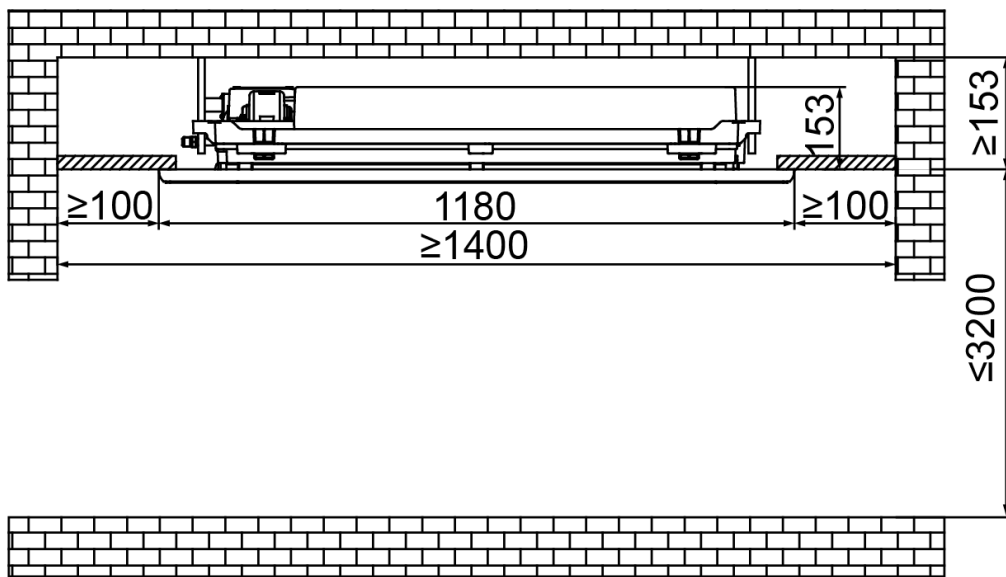


8. Wiring Diagrams

300, 400CFM


WIRING DIAGRAM

CODE	PART NAME
CAP1	INDOOR FAN CAPACITOR
CN1-22	P. C BOARD SOCKETS
TRANS	POWER TRANSFORMER
FAN1	INDOOR FAN MOTOR
K3	WATER LEVEL SWITCH
M	SWING MOTOR
P	PUMP
T1	ROOM TEMPERATURE
T2-C	PIPE TEMPERATURE
XP1-6	CONNECTORS
XS1-5	CONNECTORS
V	WATER VALVE ACTUATOR
H	ELECTRICAL HEATING
F	TEMPERATURE CONTROL SWITCH
K1	TEMPERATURE FUSE

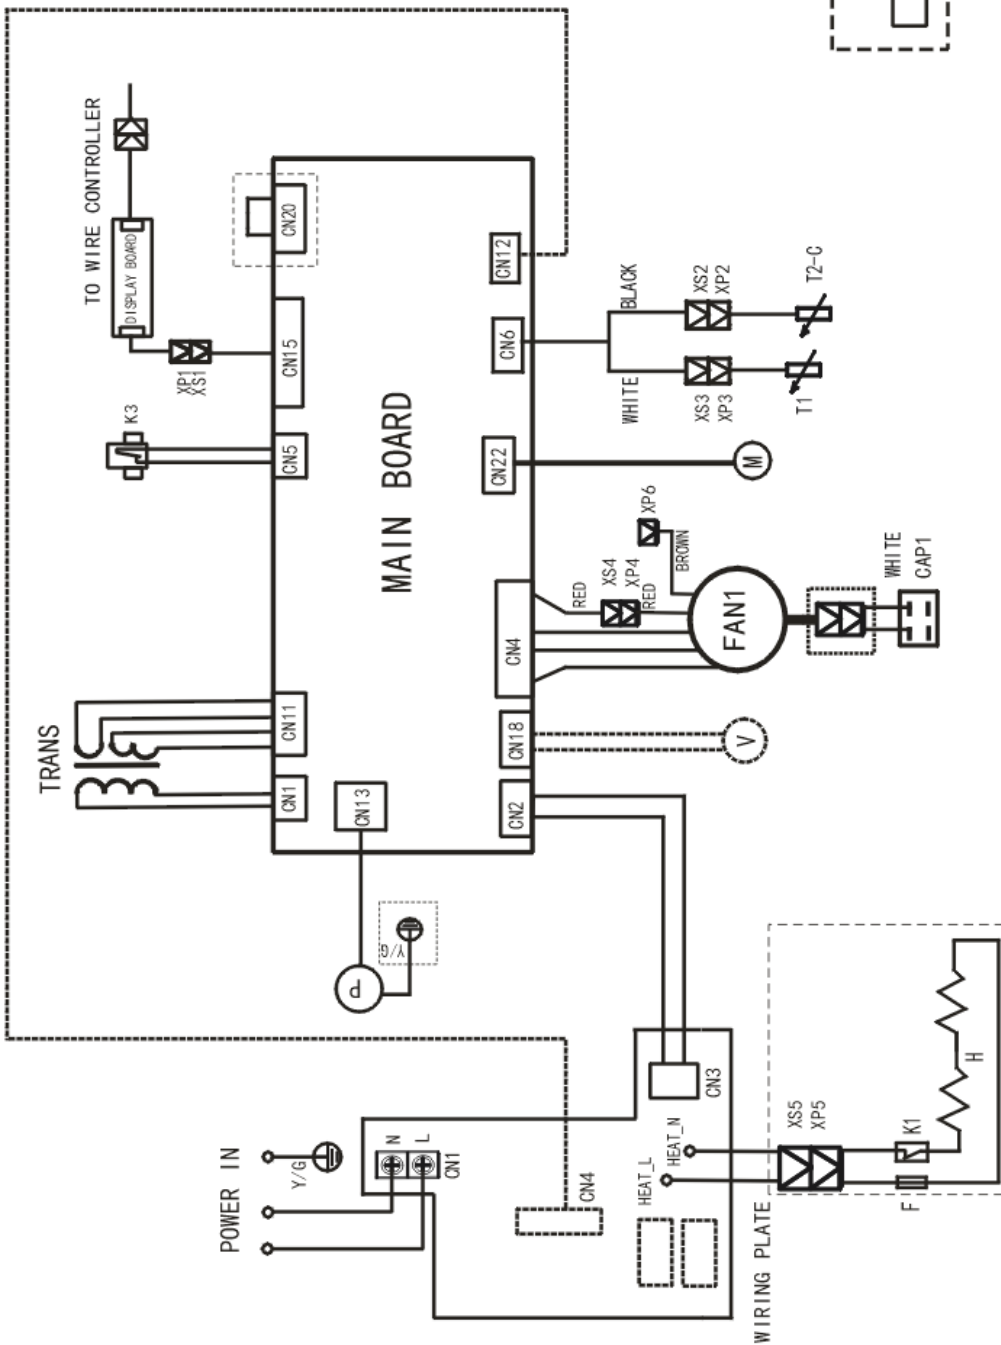

600CFM

WIRING DIAGRAM

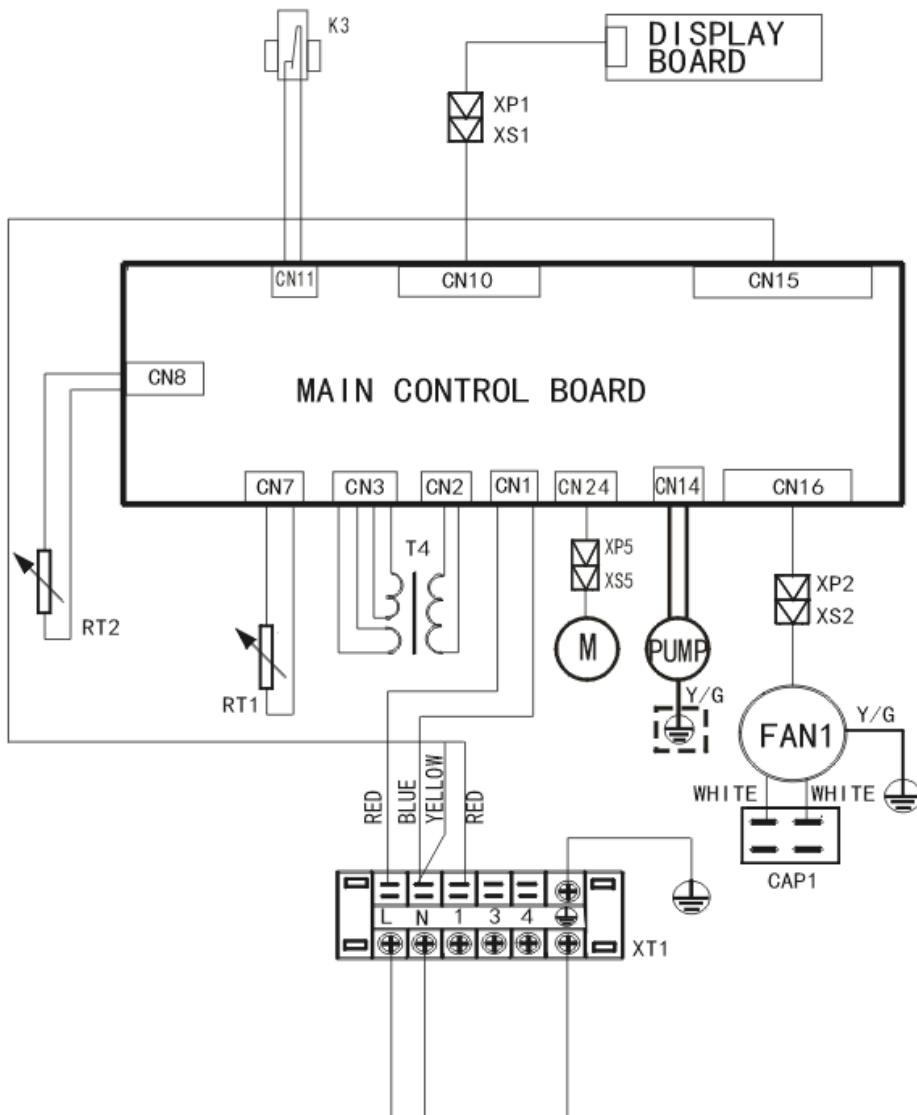

CODE	PART NAME
CAP1	INDOOR FAN CAPACITOR
CN1-16	P. C BOARD SOCKETS
T4	POWER TRANSFORMER
FAN1	INDOOR FAN MOTOR
K3	WATER LEVEL SWITCH
M	SWING MOTOR
PUMP	PUMP
RT1	ROOM TEMPERATURE
RT2	PIPE TEMPERATURE
XP1-XP7	CONNECTORS
XS1-XS7	CONNECTORS
XT1	6-WAY TERMINAL

INDOOR POWER

9. Capacity Tables

9.1 Cooling capacity tables

Remark:

EWT: Enter Water Temp. (°C); Δt: Temperature Difference (°C); DB: Dry Bulb Temp. (°C); WB: Wet Bulb Temp. (°C)

TC: Total Cooling Capacity (kW); SC: Sensible Cooling Capacity (kW); WF: Water Flow (m3/h); WPD: Water Pressure Drop (kPa)

300																					
EWT.	Δt	Air inlet condition																			
		DB:21; WB:15				DB:26.7; WB:19.4				DB:27; WB:19				DB:29; WB:21				DB:33; WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
5	3	2.51	1.82	0.72	19.5	3.87	2.33	1.11	46.3	3.79	2.43	1.09	44.5	4.24	2.22	1.21	55.4	5.7	2.76	1.63	100.4
	4	2.36	1.72	0.51	9.7	3.72	2.26	0.8	24.1	3.66	2.36	0.79	23.3	4.07	2.15	0.88	28.8	5.53	2.68	1.19	53.1
	5	2.18	1.65	0.38	5.3	3.56	2.18	0.61	14.1	3.49	2.29	0.6	13.6	3.91	2.08	0.67	17.0	5.35	2.63	0.92	31.8
	6	2	1.58	0.29	3.1	3.4	2.12	0.49	8.9	3.34	2.21	0.48	8.6	3.74	1.99	0.54	10.8	5.22	2.54	0.75	21.0
	7	1.79	1.48	0.22	1.8	3.24	2.02	0.4	5.9	3.16	2.14	0.39	5.7	3.58	1.91	0.44	7.3	5.04	2.46	0.62	14.4
	8	1.52	1.39	0.16	1.0	3.06	1.96	0.33	4.1	3	2.04	0.32	3.9	3.44	1.85	0.37	5.1	4.9	2.45	0.53	10.4
	9	1.23	1.21	0.12	0.5	2.89	1.88	0.28	2.9	2.81	1.97	0.27	2.7	3.3	1.79	0.32	3.7	4.73	2.27	0.45	7.7
6	3	2.27	1.72	0.65	15.9	3.65	2.24	1.05	41.2	3.57	2.34	1.02	39.4	4.02	2.12	1.15	50.0	5.48	2.68	1.57	92.8
	4	2.11	1.64	0.45	7.7	3.51	2.16	0.75	21.4	3.43	2.26	0.74	20.4	3.86	2.05	0.83	25.9	5.31	2.59	1.14	48.9
	5	1.95	1.56	0.34	4.2	3.34	2.08	0.57	12.4	3.27	2.19	0.56	11.9	3.71	1.97	0.64	15.3	5.13	2.5	0.88	29.3
	6	1.75	1.49	0.25	2.4	3.18	2.02	0.46	7.8	3.11	2.11	0.45	7.4	3.52	1.89	0.5	9.6	5	2.41	0.72	19.3
	7	1.54	1.39	0.19	1.3	3.01	1.93	0.37	5.2	2.94	2.05	0.36	4.9	3.36	1.81	0.41	6.4	4.83	2.37	0.59	13.2
	8	1.3	1.3	0.14	0.7	2.83	1.84	0.3	3.5	2.77	1.96	0.3	3.3	3.23	1.74	0.35	4.5	4.68	2.29	0.5	9.5
	9	0.87	0.87	0.08	0.3	2.66	1.78	0.25	2.4	2.58	1.88	0.25	2.3	3.1	1.69	0.3	3.3	4.47	2.23	0.43	6.8
7	3	2.03	1.61	0.58	12.7	3.41	2.13	0.98	36.0	3.34	2.24	0.96	34.4	3.79	2.02	1.09	44.2	5.22	2.54	1.5	84.1
	4	1.86	1.55	0.4	6.0	3.27	2.06	0.7	18.6	3.18	2.17	0.68	17.6	3.64	1.95	0.78	23.0	5.09	2.5	1.09	45.0
	5	1.68	1.48	0.29	3.2	3.11	1.98	0.53	10.7	3.04	2.09	0.52	10.3	3.46	1.87	0.6	13.3	4.91	2.41	0.85	26.8
	6	1.48	1.4	0.21	1.7	2.94	1.93	0.42	6.7	2.89	2.02	0.41	6.5	3.3	1.79	0.47	8.4	4.78	2.32	0.69	17.6
	7	1.29	1.29	0.16	0.9	2.79	1.84	0.34	4.4	2.69	1.96	0.33	4.1	3.13	1.72	0.38	5.6	4.61	2.24	0.57	12.0
	8	1.1	1.1	0.12	0.5	2.6	1.77	0.28	2.9	2.52	1.86	0.27	2.8	3	1.65	0.32	3.9	4.42	2.12	0.48	8.5
	9	0.76	0.76	0.07	0.2	2.39	1.68	0.23	2.0	2.32	1.79	0.22	1.9	2.88	1.59	0.28	2.9	4.27	2.134	0.41	6.3

EWT.	Δt	Air inlet condition																			
		DB:21; WB:15				DB:26.7; WB:19.4				DB:27; WB:19				DB:29; WB:21				DB:33; WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
8	3	1.78	1.53	0.51	9.8	3.18	2.04	0.91	31.2	3.11	2.14	0.89	29.8	3.56	1.91	1.02	39.1	5	2.46	1.43	77.2
	4	1.61	1.48	0.35	4.5	3.04	1.97	0.65	16.1	2.95	2.09	0.63	15.1	3.39	1.85	0.73	19.9	4.83	2.37	1.04	40.4
	5	1.42	1.39	0.24	2.2	2.89	1.89	0.5	9.3	2.8	2	0.48	8.7	3.24	1.78	0.56	11.7	4.69	2.28	0.81	24.5
	6	1.28	1.28	0.18	1.3	2.7	1.83	0.39	5.6	2.65	1.93	0.38	5.4	3.08	1.69	0.44	7.3	4.52	2.24	0.65	15.8
	7	1.11	1.11	0.14	0.7	2.54	1.75	0.31	3.7	2.46	1.86	0.3	3.4	2.88	1.62	0.35	4.7	4.36	2.15	0.54	10.8
	8	0.74	0.74	0.08	0.2	2.46	1.75	0.26	2.6	2.28	1.78	0.24	2.3	2.77	1.54	0.3	3.3	4.21	2.1	0.45	7.7
	9	0.66	0.66	0.06	0.2	2.31	1.73	0.22	1.8	2.05	1.72	0.2	1.4	2.66	1.59	0.25	2.4	4.02	2.01	0.38	5.6
9	3	1.52	1.44	0.44	7.2	2.96	1.95	0.85	27.0	2.87	2.04	0.82	25.5	3.32	1.82	0.95	34.0	4.78	2.37	1.37	70.6
	4	1.38	1.38	0.3	3.3	2.79	1.88	0.6	13.5	2.71	1.98	0.58	12.7	3.15	1.75	0.68	17.2	4.61	2.28	0.99	36.8
	5	1.28	1.24	0.22	1.8	2.64	1.8	0.45	7.8	2.56	1.92	0.44	7.3	3	1.67	0.52	10.0	4.47	2.19	0.77	22.3
	6	1.12	1.12	0.16	1.0	2.47	1.73	0.35	4.7	2.38	1.86	0.34	4.4	2.84	1.59	0.41	6.2	4.29	2.15	0.61	14.2
	7	0.91	0.91	0.11	0.5	2.28	1.65	0.28	3.0	2.2	1.77	0.27	2.8	2.64	1.52	0.32	4.0	4.14	2.07	0.51	9.7
	8	0.64	0.64	0.07	0.2	2.13	1.62	0.23	2.0	1.99	1.71	0.21	1.7	2.54	1.55	0.27	2.8	3.97	2.02	0.43	6.8
	9	0.55	0.55	0.05	0.1	1.98	1.62	0.19	1.3	1.73	1.65	0.17	1.0	2.43	1.53	0.23	2.0	3.78	1.93	0.36	4.9
10	3	1.34	1.34	0.38	5.6	2.71	1.85	0.78	22.7	2.6	1.97	0.75	20.9	3.09	1.72	0.89	29.4	4.56	2.24	1.31	64.3
	4	1.23	1.23	0.27	2.6	2.54	1.78	0.55	11.2	2.46	1.9	0.53	10.5	2.91	1.65	0.63	14.7	4.37	2.19	0.94	33.2
	5	1.1	1.1	0.19	1.4	2.38	1.72	0.41	6.3	2.28	1.84	0.39	5.8	2.75	1.58	0.47	8.4	4.24	2.11	0.73	20.0
	6	0.94	0.94	0.14	0.7	2.22	1.65	0.32	3.8	2.11	1.77	0.3	3.5	2.58	1.5	0.37	5.1	4.05	2.06	0.58	12.7
	7	0.6	0.6	0.07	0.2	2.02	1.57	0.25	2.3	1.93	1.71	0.24	2.1	2.41	1.43	0.3	3.3	3.87	1.97	0.48	8.5
	8	/	/	/	/	1.92	1.61	0.21	1.6	1.67	1.67	0.18	1.2	2.31	1.46	0.25	2.3	3.72	1.9	0.4	6.0
	9	/	/	/	/	1.73	1.66	0.17	1.0	1.54	1.54	0.15	0.8	2.22	1.44	0.21	1.7	3.54	1.84	0.34	4.3
11	3	1.18	1.18	0.34	4.3	2.45	1.76	0.7	18.5	2.36	1.88	0.68	17.2	2.84	1.63	0.81	24.9	4.3	2.15	1.23	57.2
	4	1.08	1.08	0.23	2.0	2.29	1.7	0.49	9.1	2.2	1.81	0.47	8.4	2.68	1.56	0.58	12.5	4.13	2.1	0.89	29.6
	5	0.94	0.94	0.16	1.0	2.12	1.64	0.36	5.0	2.02	1.76	0.35	4.5	2.5	1.49	0.43	7.0	4	2.02	0.69	17.8
	6	0.75	0.75	0.11	0.4	1.93	1.57	0.28	2.9	1.86	1.68	0.27	2.7	2.32	1.41	0.33	4.2	3.81	1.97	0.55	11.2
	7	0.5	0.5	0.06	0.1	1.72	1.51	0.21	1.7	1.66	1.66	0.2	1.6	2.14	1.33	0.26	2.6	3.64	1.89	0.45	7.5
	8	/	/	/	/	1.47	1.44	0.16	0.9	1.54	1.54	0.17	1.0	2.06	1.34	0.22	1.8	3.49	1.81	0.37	5.3
	9	/	/	/	/	1.32	1.29	0.13	0.6	1.37	1.37	0.13	0.7	1.97	1.32	0.19	1.3	3.31	1.75	0.32	3.8

EWT.	Δt	Air inlet condition																			
		DB:21; WB:15				DB:26.7; WB:19.4				DB:27; WB:19				DB:29; WB:21				DB:33; WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
12	3	1.04	1.04	0.3	3.4	2.19	1.68	0.63	14.8	2.08	1.81	0.6	13.4	2.58	1.54	0.74	20.5	4.06	2.07	1.16	50.9
	4	0.92	0.92	0.2	1.5	2.03	1.62	0.44	7.1	1.93	1.75	0.41	6.4	2.43	1.47	0.52	10.2	3.89	2	0.84	26.3
	5	0.79	0.79	0.14	0.7	1.85	1.57	0.32	3.8	1.75	1.69	0.3	3.4	2.25	1.4	0.39	5.6	3.74	1.93	0.64	15.6
	6	0.48	0.48	0.07	0.2	1.65	1.51	0.24	2.1	1.63	1.6	0.23	2.0	2.06	1.32	0.3	3.3	3.56	1.88	0.51	9.8
	7	0.39	0.39	0.05	0.1	1.46	1.46	0.18	1.2	1.5	1.5	0.18	1.3	1.87	1.25	0.23	2.0	3.39	1.8	0.42	6.5
	8	/	/	/	/	1.31	1.31	0.14	0.7	1.36	1.36	0.15	0.8	1.8	1.24	0.19	1.4	3.22	1.74	0.35	4.5
	9	/	/	/	/	1.14	1.14	0.11	0.4	1.2	1.2	0.11	0.5	1.73	1.24	0.16	1.0	3.03	1.66	0.29	3.1
13	3	0.9	0.9	0.26	2.5	1.91	1.61	0.55	11.3	1.8	1.74	0.52	10.0	2.32	1.45	0.67	16.7	3.8	1.99	1.09	44.7
	4	0.77	0.77	0.17	1.0	1.75	1.54	0.38	5.3	1.69	1.66	0.36	5.0	2.16	1.38	0.46	8.1	3.64	1.91	0.78	23.0
	5	0.55	0.55	0.1	0.3	1.56	1.53	0.27	2.7	1.58	1.58	0.27	2.8	1.99	1.32	0.34	4.4	3.48	1.84	0.6	13.5
	6	0.37	0.37	0.05	0.1	1.42	1.42	0.2	1.6	1.47	1.47	0.21	1.7	1.79	1.25	0.26	2.5	3.3	1.79	0.47	8.4
	7	0.27	0.27	0.03	0.0	1.3	1.3	0.16	1.0	1.35	1.35	0.17	1.0	1.57	1.18	0.19	1.4	3.13	1.72	0.38	5.6
	8	/	/	/	/	1.14	1.14	0.12	0.6	1.2	1.2	0.13	0.6	1.51	1.12	0.16	1.0	2.96	1.63	0.32	3.8
	9	/	/	/	/	0.92	0.92	0.09	0.3	1	1	0.1	0.3	1.45	1.16	0.14	0.7	2.76	1.57	0.26	2.6
14	3	/	/	/	/	1.6	1.56	0.46	8.0	1.63	1.63	0.47	8.2	2.09	1.57	0.6	13.5	3.56	1.89	1.02	39.1
	4	/	/	/	/	1.5	1.47	0.32	3.9	1.54	1.54	0.33	4.1	1.9	1.48	0.41	6.3	3.39	1.83	0.73	19.9
	5	/	/	/	/	1.5	1.5	0.26	2.5	1.44	1.44	0.25	2.3	1.73	1.42	0.3	3.3	3.2	1.79	0.55	11.4
	6	/	/	/	/	1.5	1.5	0.21	1.7	1.31	1.31	0.19	1.3	1.55	1.32	0.22	1.9	3.04	1.7	0.44	7.2
	7	/	/	/	/	1.13	1.13	0.14	0.7	1.18	1.18	0.14	0.8	1.3	1.14	0.16	1.0	2.87	1.64	0.35	4.7
	8	/	/	/	/	1.5	1.5	0.16	1.0	1.02	1.02	0.11	0.5	1.24	1.14	0.13	0.7	2.68	1.58	0.29	3.1
	9	/	/	/	/	0.63	0.63	0.06	0.1	0.65	0.65	0.06	0.2	1.19	1.13	0.11	0.5	2.48	1.51	0.24	2.1
15	3	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	3.29	1.81	0.94	33.4
	4	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	3.13	1.75	0.67	17.0
	5	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	2.94	1.71	0.51	9.6
	6	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	2.78	1.64	0.4	6.0
	7	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	2.59	1.56	0.32	3.8
	8	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	2.4	1.51	0.26	2.5
	9	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	2.21	1.43	0.21	1.7

Cooling capacity table

400																					
EWT.	Δt	Air inlet condition																			
		DB:21; WB:15				DB:26.7; WB:19.4				DB:27; WB:19				DB:29; WB:21				DB:33; WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
5	3	3.13	2.28	0.9	27.4	4.83	2.91	1.38	65.2	4.73	3.04	1.36	62.5	5.28	2.77	1.51	78.0	7.11	3.45	2.04	141.3
	4	2.95	2.15	0.63	13.7	4.64	2.82	1	33.9	4.57	2.95	0.98	32.8	5.08	2.68	1.09	40.5	6.89	3.34	1.48	74.6
	5	2.72	2.06	0.47	7.5	4.44	2.72	0.76	19.8	4.35	2.85	0.75	19.1	4.88	2.59	0.84	23.9	6.67	3.28	1.15	44.8
	6	2.49	1.97	0.36	4.3	4.24	2.65	0.61	12.6	4.16	2.76	0.6	12.1	4.67	2.48	0.67	15.2	6.51	3.17	0.93	29.6
	7	2.23	1.84	0.27	2.6	4.04	2.52	0.5	8.4	3.94	2.66	0.48	8.0	4.47	2.38	0.55	10.3	6.29	3.06	0.77	20.3
	8	1.9	1.73	0.2	1.4	3.82	2.44	0.41	5.7	3.74	2.54	0.4	5.5	4.29	2.31	0.46	7.2	6.11	3.05	0.66	14.7
	9	1.54	1.5	0.15	0.7	3.61	2.34	0.34	4.0	3.51	2.46	0.34	3.8	4.12	2.24	0.39	5.3	5.89	2.83	0.56	10.8
6	3	2.83	2.14	0.81	22.4	4.56	2.79	1.31	58.0	4.45	2.91	1.28	55.4	5.02	2.65	1.44	70.3	6.84	3.34	1.96	130.6
	4	2.63	2.04	0.57	10.9	4.38	2.7	0.94	30.1	4.27	2.82	0.92	28.7	4.81	2.56	1.03	36.4	6.62	3.23	1.42	68.8
	5	2.43	1.95	0.42	5.9	4.16	2.6	0.72	17.4	4.08	2.73	0.7	16.7	4.62	2.46	0.79	21.5	6.4	3.12	1.1	41.2
	6	2.18	1.86	0.31	3.3	3.97	2.52	0.57	11.0	3.87	2.63	0.55	10.5	4.39	2.35	0.63	13.5	6.23	3.01	0.89	27.2
	7	1.92	1.73	0.24	1.9	3.76	2.41	0.46	7.3	3.66	2.56	0.45	6.9	4.19	2.25	0.52	9.0	6.02	2.95	0.74	18.6
	8	1.62	1.62	0.17	1.0	3.53	2.29	0.38	4.9	3.45	2.45	0.37	4.7	4.03	2.17	0.43	6.4	5.84	2.86	0.63	13.4
	9	1.08	1.08	0.1	0.4	3.31	2.22	0.32	3.4	3.21	2.34	0.31	3.2	3.87	2.11	0.37	4.6	5.57	2.78	0.53	9.6
7	3	2.53	2.01	0.73	17.9	4.25	2.66	1.22	50.6	4.16	2.79	1.19	48.4	4.72	2.52	1.35	62.3	6.51	3.17	1.87	118.4
	4	2.32	1.94	0.5	8.5	4.08	2.56	0.88	26.2	3.97	2.7	0.85	24.8	4.53	2.43	0.97	32.3	6.34	3.12	1.36	63.3
	5	2.1	1.84	0.36	4.4	3.87	2.47	0.67	15.1	3.79	2.61	0.65	14.5	4.32	2.34	0.74	18.7	6.13	3.01	1.05	37.7
	6	1.85	1.75	0.26	2.4	3.67	2.4	0.53	9.4	3.6	2.52	0.52	9.1	4.12	2.23	0.59	11.9	5.96	2.9	0.85	24.8
	7	1.6	1.6	0.2	1.3	3.47	2.29	0.43	6.2	3.36	2.44	0.41	5.8	3.9	2.14	0.48	7.8	5.74	2.79	0.71	16.9
	8	1.37	1.37	0.15	0.7	3.24	2.21	0.35	4.1	3.14	2.32	0.34	3.9	3.74	2.05	0.4	5.5	5.51	27.57	0.59	12.0
	9	0.94	0.94	0.09	0.3	2.98	2.09	0.29	2.8	2.89	2.23	0.28	2.6	3.59	1.99	0.34	4.0	5.32	26.6	0.51	8.8
8	3	2.22	1.91	0.64	13.8	3.97	2.54	1.14	43.9	3.87	2.66	1.11	41.9	4.44	2.38	1.27	55.0	6.23	3.06	1.79	108.6
	4	2	1.85	0.43	6.3	3.79	2.46	0.81	22.6	3.68	2.6	0.79	21.2	4.22	2.31	0.91	28.0	6.02	2.95	1.29	56.9
	5	1.77	1.73	0.3	3.2	3.6	2.35	0.62	13.0	3.49	2.49	0.6	12.3	4.04	2.21	0.7	16.4	5.85	2.84	1.01	34.5
	6	1.59	1.59	0.23	1.8	3.36	2.28	0.48	7.9	3.3	2.41	0.47	7.6	3.84	2.11	0.55	10.3	5.63	2.79	0.81	22.2
	7	1.39	1.39	0.17	1.0	3.17	2.18	0.39	5.2	3.07	2.32	0.38	4.8	3.59	2.02	0.44	6.6	5.44	2.69	0.67	15.2
	8	0.92	0.92	0.1	0.3	3.07	2.18	0.33	3.7	2.84	2.21	0.31	3.2	3.45	1.91	0.37	4.7	5.24	2.62	0.56	10.8
	9	0.82	0.82	0.08	0.2	2.88	2.16	0.28	2.6	2.56	2.15	0.24	2.0	3.31	1.98	0.32	3.4	5.02	2.51	0.48	7.8

EWT.	Δt	Air inlet condition																			
		DB:21; WB:15				DB:26.7; WB:19.4				DB:27; WB:19				DB:29; WB:21				DB:33; WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
9	3	1.9	1.8	0.54	10.1	3.69	2.43	1.06	38.0	3.58	2.55	1.03	35.9	4.14	2.26	1.19	47.9	5.96	2.95	1.71	99.3
	4	1.72	1.72	0.37	4.7	3.48	2.34	0.75	19.0	3.37	2.47	0.73	17.9	3.93	2.18	0.84	24.2	5.74	2.84	1.23	51.8
	5	1.59	1.54	0.27	2.6	3.29	2.24	0.57	10.9	3.19	2.39	0.55	10.2	3.74	2.08	0.64	14.0	5.58	2.73	0.96	31.3
	6	1.39	1.39	0.2	1.4	3.07	2.16	0.44	6.6	2.96	2.31	0.42	6.1	3.54	1.99	0.51	8.8	5.34	2.67	0.77	19.9
	7	1.14	1.14	0.14	0.7	2.84	2.06	0.35	4.2	2.75	2.21	0.34	3.9	3.29	1.9	0.4	5.6	5.16	2.58	0.63	13.7
	8	0.8	0.8	0.09	0.3	2.65	2.02	0.29	2.8	2.48	2.13	0.27	2.4	3.16	1.93	0.34	3.9	4.95	2.52	0.53	9.6
	9	0.68	0.68	0.07	0.1	2.46	2.02	0.24	1.9	2.16	2.05	0.21	1.5	3.03	1.91	0.29	2.9	4.71	2.4	0.45	6.9
10	3	1.67	1.67	0.48	7.8	3.38	2.3	0.97	31.9	3.24	2.46	0.93	29.4	3.85	2.14	1.1	41.4	5.69	2.79	1.63	90.4
	4	1.54	1.54	0.33	3.7	3.17	2.21	0.68	15.8	3.06	2.37	0.66	14.7	3.63	2.06	0.78	20.7	5.45	2.73	1.17	46.7
	5	1.37	1.37	0.24	1.9	2.96	2.14	0.51	8.8	2.84	2.3	0.49	8.1	3.43	1.97	0.59	11.9	5.28	2.64	0.91	28.1
	6	1.18	1.18	0.17	1.0	2.76	2.05	0.4	5.3	2.64	2.21	0.38	4.9	3.21	1.87	0.46	7.2	5.05	2.56	0.72	17.8
	7	0.75	0.75	0.09	0.3	2.52	1.96	0.31	3.3	2.4	2.13	0.29	3.0	3	1.78	0.37	4.6	4.83	2.46	0.59	12.0
	8	/	/	/	/	2.39	2.01	0.26	2.2	2.08	2.08	0.22	1.7	2.88	1.82	0.31	3.3	4.64	2.37	0.5	8.5
	9	/	/	/	/	2.16	2.07	0.21	1.5	1.92	1.92	0.18	1.1	2.77	1.8	0.26	2.4	4.42	2.3	0.42	6.1
11	3	1.48	1.48	0.42	6.1	3.05	2.2	0.87	26.0	2.94	2.34	0.84	24.2	3.54	2.03	1.01	35.0	5.37	2.69	1.54	80.4
	4	1.35	1.35	0.29	2.9	2.86	2.12	0.61	12.9	2.75	2.25	0.59	11.9	3.34	1.95	0.72	17.6	5.15	2.61	1.11	41.6
	5	1.17	1.17	0.2	1.4	2.64	2.04	0.45	7.0	2.52	2.2	0.43	6.4	3.12	1.85	0.54	9.8	4.98	2.52	0.86	25.0
	6	0.93	0.93	0.13	0.6	2.41	1.96	0.34	4.1	2.31	2.1	0.33	3.7	2.9	1.76	0.42	5.9	4.75	2.46	0.68	15.8
	7	0.63	0.63	0.08	0.2	2.14	1.89	0.26	2.4	2.07	2.07	0.25	2.2	2.67	1.66	0.33	3.7	4.53	2.35	0.56	10.6
	8	/	/	/	/	1.83	1.8	0.2	1.3	1.91	1.91	0.21	1.4	2.56	1.67	0.28	2.6	4.35	2.26	0.47	7.4
	9	/	/	/	/	1.64	1.61	0.16	0.8	1.71	1.71	0.16	0.9	2.46	1.65	0.24	1.9	4.13	2.19	0.39	5.3
12	3	1.3	1.3	0.37	4.7	2.73	2.09	0.78	20.8	2.6	2.26	0.74	18.9	3.22	1.92	0.92	28.9	5.06	2.58	1.45	71.7
	4	1.15	1.15	0.25	2.1	2.53	2.02	0.54	10.0	2.4	2.18	0.52	9.1	3.02	1.83	0.65	14.4	4.85	2.5	1.04	37.0
	5	0.99	0.99	0.17	1.0	2.31	1.95	0.4	5.4	2.19	2.11	0.38	4.8	2.81	1.75	0.48	7.9	4.67	2.41	0.8	21.9
	6	0.6	0.6	0.09	0.3	2.05	1.89	0.29	2.9	2.03	1.99	0.29	2.9	2.57	1.65	0.37	4.6	4.44	2.34	0.64	13.8
	7	0.49	0.49	0.06	0.1	1.82	1.82	0.22	1.7	1.87	1.87	0.23	1.8	2.34	1.55	0.29	2.8	4.22	2.25	0.52	9.2
	8	/	/	/	/	1.63	1.63	0.18	1.1	1.7	1.7	0.18	1.1	2.24	1.55	0.24	2.0	4.02	2.17	0.43	6.3
	9	/	/	/	/	1.42	1.42	0.14	0.6	1.49	1.49	0.14	0.7	2.15	1.55	0.21	1.4	3.77	2.08	0.36	4.4

EWT.	Δt	Air inlet condition																			
		DB:21; WB:15				DB:26.7; WB:19.4				DB:27; WB:19				DB:29; WB:21				DB:33; WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
13	3	1.12	1.12	0.32	3.5	2.38	2	0.68	15.9	2.25	2.17	0.64	14.1	2.9	1.81	0.83	23.5	4.74	2.48	1.36	62.8
	4	0.96	0.96	0.21	1.4	2.18	1.93	0.47	7.5	2.11	2.07	0.45	7.0	2.69	1.72	0.58	11.4	4.54	2.38	0.98	32.4
	5	0.69	0.69	0.12	0.5	1.95	1.9	0.33	3.8	1.97	1.97	0.34	3.9	2.48	1.64	0.43	6.2	4.34	2.29	0.75	18.9
	6	0.46	0.46	0.07	0.2	1.77	1.77	0.25	2.2	1.83	1.83	0.26	2.3	2.24	1.55	0.32	3.5	4.11	2.23	0.59	11.8
	7	0.34	0.34	0.04	0.1	1.62	1.62	0.2	1.4	1.68	1.68	0.21	1.5	1.96	1.47	0.24	2.0	3.9	2.14	0.48	7.8
	8	/	/	/	/	1.42	1.42	0.15	0.8	1.5	1.5	0.16	0.9	1.88	1.39	0.2	1.4	3.69	2.03	0.4	5.3
	9	/	/	/	/	1.15	1.15	0.11	0.4	1.24	1.24	0.12	0.5	1.8	1.44	0.17	1.0	3.44	1.96	0.33	3.7
14	3	/	/	/	/	2	1.94	0.57	11.2	2.03	2.03	0.58	11.5	2.61	1.96	0.75	19.0	4.44	2.35	1.27	55.1
	4	/	/	/	/	1.87	1.83	0.4	5.5	1.92	1.92	0.41	5.8	2.37	1.85	0.51	8.9	4.22	2.28	0.91	28.0
	5	/	/	/	/	1.87	1.87	0.32	3.5	1.79	1.79	0.31	3.2	2.16	1.77	0.37	4.7	4	2.24	0.69	16.1
	6	/	/	/	/	1.87	1.87	0.27	2.4	1.64	1.64	0.23	1.9	1.93	1.64	0.28	2.6	3.8	2.13	0.54	10.1
	7	/	/	/	/	1.41	1.41	0.17	1.0	1.47	1.47	0.18	1.1	1.61	1.42	0.2	1.3	3.58	2.04	0.44	6.6
	8	/	/	/	/	1.87	1.87	0.2	1.4	1.27	1.27	0.14	0.6	1.54	1.42	0.17	0.9	3.34	1.97	0.36	4.4
	9	/	/	/	/	0.78	0.78	0.07	0.2	0.81	0.81	0.08	0.2	1.48	1.41	0.14	0.7	3.09	1.88	0.29	3.0
15	3	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	4.1	2.26	1.18	47.1
	4	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	3.9	2.18	0.84	23.9
	5	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	3.67	2.13	0.63	13.6
	6	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	3.47	2.05	0.5	8.4
	7	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	3.23	1.94	0.4	5.4
	8	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	2.99	1.88	0.32	3.5
	9	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	/	2.75	1.79	0.26	2.4

Cooling capacity table

600																					
EWT	Δt	Air inlet condition																			
		DB:21 WB:15				DB:26.7 WB:19.4				DB:27 WB:19				DB:29 WB:21				DB:33 WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
5	3	4.72	3.43	1.35	38.4	7.27	4.38	2.09	91.1	7.13	4.57	2.04	87.4	7.96	4.18	2.28	109	10.71	5.19	3.07	197.5
	4	4.44	3.24	0.95	19.1	6.99	4.25	1.5	47.4	6.88	4.44	1.48	45.8	7.64	4.04	1.64	56.6	10.38	5.03	2.23	104.3
	5	4.1	3.1	0.71	10.4	6.69	4.1	1.15	27.7	6.56	4.3	1.13	26.7	7.35	6.35	1.26	33.5	10.05	4.94	1.73	62.6
	6	3.75	2.97	0.54	6	6.39	3.99	0.92	17.6	6.27	4.15	0.9	16.9	7.03	3.74	1.01	21.3	9.8	4.78	1.41	41.4
	7	3.36	2.78	0.41	3.6	6.08	3.8	0.75	11.7	5.94	4.01	0.73	11.2	6.73	3.59	0.83	14.3	9.47	4.61	1.16	28.4
6	3	4.27	3.23	1.22	31.4	6.86	4.21	1.97	81.1	6.71	4.39	1.92	77.4	7.55	3.99	2.17	98.2	10.3	5.03	2.95	182.6
	4	3.96	3.07	0.85	15.2	6.59	4.06	1.42	42.1	6.43	4.24	1.38	40.1	7.25	3.86	1.56	50.9	9.97	4.86	2.14	96.2
	5	3.66	2.93	0.63	8.3	6.27	3.91	1.08	24.4	6.15	4.12	1.06	23.4	6.96	3.71	1.2	30	9.64	4.7	1.66	57.6
	6	3.29	2.8	0.47	4.7	5.97	3.8	0.86	15.4	5.83	3.96	0.84	14.6	6.62	3.54	0.95	18.8	9.39	4.53	1.35	38
	7	2.89	2.6	0.36	2.6	5.66	3.62	0.7	10.1	5.52	3.86	0.68	9.6	6.32	3.39	0.78	12.6	9.06	4.45	1.11	26
7	3	3.81	3.03	1.09	25	6.41	4	1.84	70.7	6.27	4.21	1.8	67.7	7.11	3.79	2.04	87	9.8	4.78	2.81	165.5
	4	3.5	2.92	0.75	11.9	6.15	3.86	1.32	36.6	5.98	4.07	1.29	34.6	6.83	3.67	1.47	45.2	9.56	4.7	2.05	88.4
	5	3.16	2.78	0.54	6.2	5.83	3.72	1	21.1	5.71	3.93	0.98	20.2	6.5	3.52	1.12	26.2	9.23	4.53	1.59	52.8
	6	2.78	2.64	0.4	3.3	5.53	3.62	0.79	13.2	5.43	3.79	0.78	12.7	6.2	3.36	0.89	16.6	8.98	4.37	1.29	34.7
	7	2.41	2.41	0.3	1.8	5.23	3.45	0.64	8.7	5.06	3.67	0.62	8.1	5.87	3.22	0.72	10.9	8.65	4.2	1.06	23.7
8	3	3.34	2.88	0.96	19.3	5.97	3.83	1.71	61.4	5.83	4.01	1.67	58.6	6.68	3.58	1.92	76.8	9.39	4.61	2.69	151.8
	4	3.02	2.78	0.65	8.8	5.71	3.7	1.23	31.6	5.54	3.92	1.19	29.7	6.36	3.48	1.37	39.2	9.06	4.45	1.95	79.5
	5	2.67	2.61	0.46	4.4	5.42	3.54	0.93	18.2	5.26	3.76	0.9	17.1	6.09	3.34	1.05	23	8.81	4.28	1.52	48.2
	6	2.4	2.4	0.34	2.5	5.07	3.44	0.73	11	4.97	3.62	0.71	10.6	5.78	3.18	0.83	14.4	8.49	4.2	1.22	31
	7	2.09	2.09	0.26	1.4	4.77	3.28	0.59	7.2	4.62	3.5	0.57	6.8	5.41	3.05	0.66	9.3	8.19	4.04	1.01	21.2
9	3	2.86	2.71	0.82	14.1	5.55	3.66	1.59	53.1	5.4	3.84	1.55	50.1	6.24	3.41	1.79	67	8.98	4.45	2.57	138.8
	4	2.6	2.6	0.56	6.5	5.24	3.53	1.13	26.6	5.08	3.72	1.09	25	5.91	3.29	1.27	33.9	8.65	4.28	1.86	72.5
	5	2.4	2.32	0.41	3.6	4.96	3.38	0.85	15.2	4.8	3.6	0.83	14.3	5.63	3.14	0.97	19.6	8.4	4.12	1.45	43.8
	6	2.1	2.1	0.3	1.9	4.63	3.25	0.66	9.2	4.47	3.48	0.64	8.6	5.33	2.99	0.76	12.2	8.05	4.03	1.15	27.9
	7	1.71	1.71	0.21	0.9	4.28	3.1	0.53	5.8	4.14	3.33	0.51	5.4	4.96	2.86	0.61	7.8	7.78	3.88	0.96	19.1

EWT	Δt	Air inlet condition																			
		DB:21 WB:15				DB:26.7 WB:19.4				DB:27 WB:19				DB:29 WB:21				DB:33 WB:25			
		TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
10	3	2.52	2.52	0.72	10.9	5.09	3.47	1.46	44.6	4.89	3.7	1.4	41.1	5.8	3.23	1.66	57.9	8.57	4.2	2.46	126.4
	4	2.31	2.31	0.5	5.2	4.78	3.34	1.03	22.1	4.61	3.58	0.99	20.6	5.46	3.11	1.17	28.9	8.21	4.12	1.77	65.3
	5	2.07	2.07	0.36	2.6	4.47	3.23	0.77	12.4	4.28	3.46	0.74	11.3	5.17	2.97	0.89	16.6	7.96	3.97	1.37	39.2
	6	1.77	1.77	0.25	1.4	4.16	3.09	0.6	7.4	3.97	3.33	0.57	6.8	4.84	2.82	0.69	10.1	7.61	3.86	1.09	24.9
	7	1.13	1.13	0.14	0.4	3.8	2.96	0.47	4.6	3.62	3.2	0.44	4.1	4.52	2.68	0.56	6.5	7.27	3.71	0.89	16.7
11	3	2.22	2.22	0.64	8.5	4.6	3.31	1.32	36.4	4.43	3.53	1.27	33.8	5.33	3.06	1.53	48.9	8.08	4.04	2.32	112.4
	4	2.03	2.03	0.44	4	4.31	3.2	0.93	18	4.14	3.39	0.89	16.6	5.03	2.93	1.08	24.5	7.75	3.94	1.67	58.2
	5	1.76	1.76	0.3	1.9	3.98	3.07	0.68	9.8	3.8	3.31	0.65	8.9	4.7	2.79	0.81	13.7	7.5	3.8	1.29	34.9
	6	1.4	1.4	0.2	0.8	3.62	2.95	0.52	5.7	3.48	3.16	0.5	5.2	4.37	2.65	0.63	8.2	7.16	3.7	1.03	22.1
	7	0.95	0.95	0.12	0.3	3.23	2.84	0.4	3.3	3.11	3.11	0.38	3.1	4.02	2.5	0.49	5.1	6.83	3.54	0.84	14.7
12	3	1.96	1.96	0.56	6.6	4.11	3.16	1.18	29.1	3.91	3.4	1.12	26.4	4.84	2.89	1.39	40.4	7.63	3.89	2.19	100.2
	4	1.73	1.73	0.37	2.9	3.81	3.05	0.82	14	3.62	3.29	0.78	12.7	4.56	2.76	0.98	20.1	7.31	3.76	1.57	51.7
	5	1.49	1.49	0.26	1.4	3.48	2.94	0.6	7.5	3.3	3.18	0.57	6.7	4.23	2.64	0.73	11.1	7.03	3.62	1.21	30.6
	6	0.9	0.9	0.13	0.3	3.09	2.84	0.44	4.1	3.06	3	0.44	4	3.87	2.49	0.55	6.5	6.69	3.53	0.96	19.3
	7	0.74	0.74	0.09	0.2	2.74	2.74	0.34	2.4	2.82	2.82	0.35	2.5	3.52	2.34	0.43	3.9	6.36	3.39	0.78	12.8
13	3	1.69	1.69	0.48	4.9	3.59	3.02	1.03	22.2	3.39	3.27	0.97	19.7	4.37	2.73	1.25	32.8	7.14	3.73	2.05	87.8
	4	1.44	1.44	0.31	2	3.29	2.9	0.71	10.5	3.17	3.11	0.68	9.7	4.05	2.6	0.87	15.9	6.84	3.59	1.47	45.3
	5	1.04	1.04	0.18	0.7	2.93	2.87	0.5	5.3	2.97	2.97	0.51	5.5	3.73	2.47	0.64	8.6	6.53	3.45	1.12	26.5
	6	0.69	0.69	0.1	0.2	2.67	2.67	0.38	3.1	2.76	2.76	0.4	3.3	3.37	2.34	0.48	4.9	6.2	3.36	0.89	16.5
	7	0.51	0.51	0.06	0.1	2.44	2.44	0.3	1.9	2.54	2.54	0.31	2	2.95	2.21	0.36	2.8	5.87	3.22	0.72	10.9

Cooling capacity modification coefficient table:

Speed	300		400		600	
	TC	SC	TC	SC	TC	SC
High	1	1	1	1	1	1
Mid	0.92	0.88	0.94	0.9	0.89	0.87
Low	0.84	0.8	0.89	0.85	0.84	0.83

9.2 Heating capacity tables

Remark:

Δt: Temperature Difference (°C) ; TH: Total Heating Capacity (kW); WF: Water Flow (m³/h); WPD: Water Pressure Drop (kPa)

300																											
Δt	Air inlet temp. (20°C DB)																										
	Water inlet temp. (°C)																										
	35			40			45			50			55			60			65			70					
	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
20	—	—	—	—	—	—	1.48	0.06	0.1	3.41	0.15	0.8	4.61	0.2	1.4	5.74	0.25	2.2	6.8	0.29	3.1	7.93	0.34	4.3			
15	—	—	—	—	—	—	3.13	0.18	1.2	4.27	0.24	2.2	5.32	0.3	3.4	6.42	0.37	5	7.36	0.42	6.5	8.56	0.49	8.8			
10	1.79	0.15	0.9	2.81	0.24	2.1	3.9	0.34	4.1	4.92	0.42	6.6	5.94	0.51	9.6	6.99	0.6	13.3	7.99	0.69	17.4	9	0.77	22			
8	1.99	0.21	1.7	3.1	0.33	4.1	4.15	0.45	7.3	5.17	0.56	11.4	6.17	0.66	16.1	7.17	0.77	21.8	8.18	0.88	28.4	9.19	0.99	35.8			
6	2.3	0.33	4	3.35	0.48	8.5	4.35	0.62	14.3	5.4	0.77	22	6.42	0.92	31.1	7.43	1.06	41.6	8.37	1.2	52.9	9.44	1.35	67.2			
400																											
Δt	Air inlet temp. (20°C DB)																										
	Water inlet temp. (°C)																										
	35			40			45			50			55			60			65			70					
	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
20	—	—	—	—	—	—	1.85	0.08	0.2	4.26	0.18	1.3	5.76	0.25	2.4	7.17	0.31	3.7	8.5	0.37	5.1	9.91	0.43	7			
15	—	—	—	—	—	—	3.91	0.22	1.9	5.33	0.31	3.6	6.65	0.38	5.6	8.02	0.46	8.1	9.2	0.53	10.7	10.7	0.61	14.5			
10	2.24	0.19	1.4	3.52	0.3	3.5	4.87	0.42	6.7	6.14	0.53	10.7	7.43	0.64	15.7	8.73	0.75	21.7	9.99	0.86	28.4	11.25	0.97	36			
8	2.49	0.27	2.7	3.87	0.42	6.7	5.18	0.56	11.9	6.47	0.7	18.6	7.71	0.83	26.4	8.97	0.96	35.7	10.23	1.1	46.5	11.49	1.23	58.6			
6	2.88	0.41	6.6	4.19	0.6	13.9	5.44	0.78	23.3	6.75	0.97	36	8.02	1.15	50.9	9.28	1.33	68.1	10.46	1.5	86.5	11.8	1.69	110			
600																											
Δt	Air inlet temp. (20°C DB)																										
	Water inlet temp. (°C)																										
	35			40			45			50			55			60			65			70					
	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
10	3.26	0.28	0.4	5.11	0.44	1.1	7.07	0.61	2.1	8.92	0.77	3.3	10.78	0.93	4.8	12.68	1.09	6.6	14.51	1.25	8.7	16.33	1.4	11			
8	3.61	0.39	0.8	5.62	0.6	2	7.53	0.81	3.7	9.39	1.01	5.7	11.19	1.2	8.1	13.02	1.4	10.9	14.85	1.6	14.2	16.68	1.79	17.9			
6	4.18	0.6	2	6.09	0.87	4.2	7.89	1.13	7.1	9.8	1.4	11	11.65	1.67	15.5	13.48	1.93	20.8	15.19	2.18	26.4	17.13	2.46	33.6			

Heating capacity modification coefficient table:

Speed	300	400	600
	TH	TH	TH
High	1	1	1
Mid	0.91	0.91	0.88
Low	0.78	0.79	0.78



Altitude modification coefficient table:

Altitude	TC	SC	TH
500	0.98	0.95	0.95
1000	0.97	0.91	0.91
1500	0.95	0.86	0.86
2000	0.94	0.82	0.82
2500	0.93	0.78	0.78
3000	0.91	0.74	0.7

10. Installation


10.1 Installation space

- Please avoid installing in the following places:
 - A place with flammable gas or material;
 - A saline place such as a seashore vicinity;
 - A place with sulfur gas;
 - A place with oil gas, such as kitchen;
 - A place with high-humidity air;
 - An unbearable place;
 - A place where high-frequency waves are generated;
 - The appliance shall not be installed in the laundry.
- Please comply with the related national electric standard to make electric insulation for construction and metal parts of air-conditioner.
- Please choose the place where the ventilation is good.
- Ceiling space requires $\geq 170\text{mm}$;
- The installation height of the unit can not higher than 3.2 m, or it will affect the operation effect.

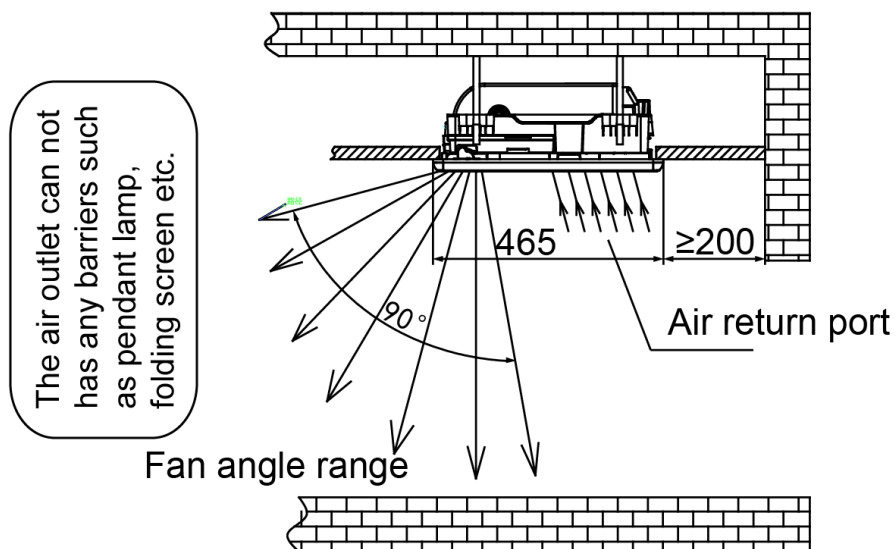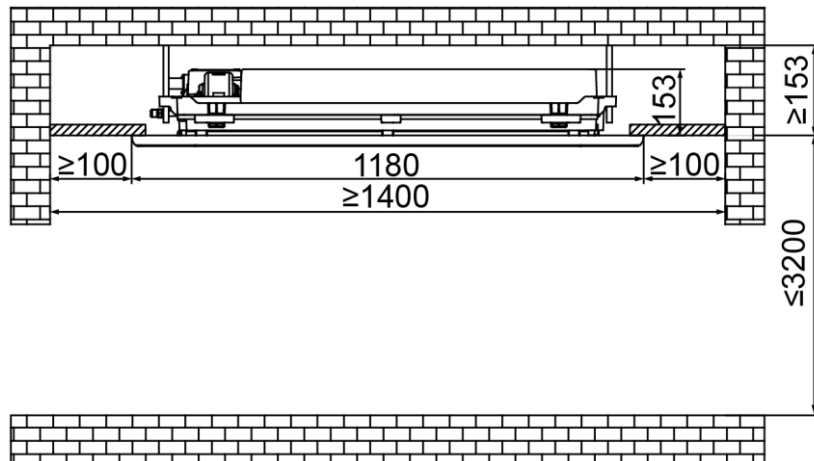


10.2 Units installation

- Please use the installation paper plate to make sure the positions of the installation screws.

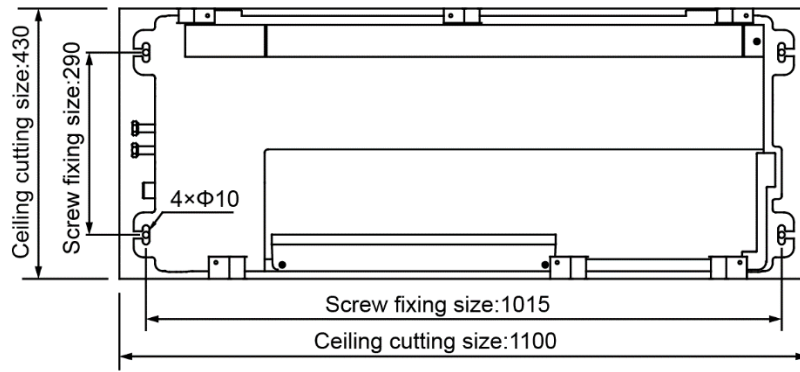


- Please accord to the follow figure's requirements to design the length of the suspender bolt.

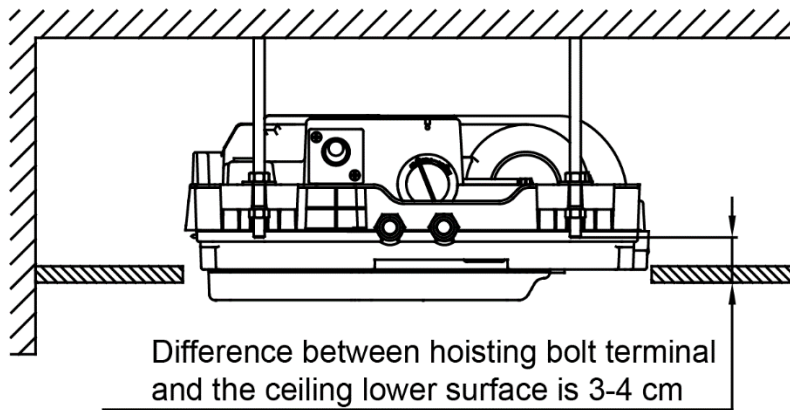

- Please install with $\Phi 10$ hanging screw bolts.
 - The handling to the ceiling varies from the constructions; consult the construction person for the specific condition.
 - The size of the ceiling to be handled. Do keep the ceiling flat. Consolidate the roof beam for possible vibration.
 - Cut off the roof beam.
 - Strengthen the place that has been cut off, and consolidate the roof beam.
 - Connect wires and pipes inside the ceiling after the air conditioner is hanged.
 - After the selection of installation location, position the refrigerant pipes, drain pipes, indoor & outdoor wires to the connection places before hanging up the machine.
 - The installation of hanging screw bolts.



Wooden construction

- Put the square timber over the roof beam, and then install the hanging screw bolts.

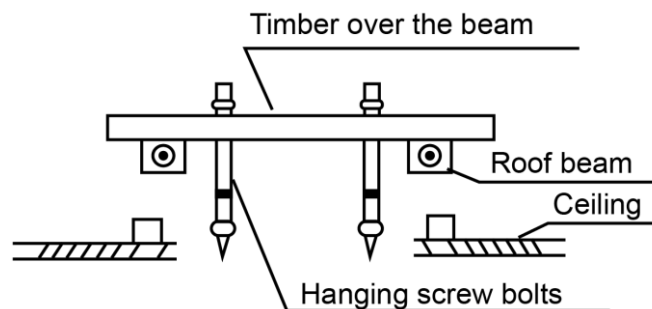


New Concrete Bricks

- Inlaying or embedding the screw bolts.

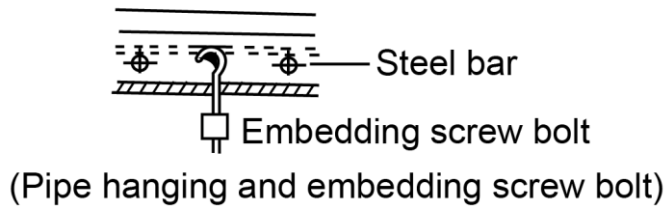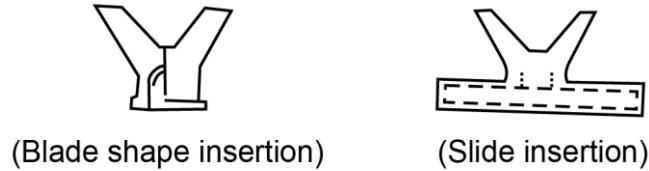


For finished concrete bricks

- Install the hanging hook with expansible bolt into the concrete deep to 45~50mm to prevent loose.




Steel roof beam structure


- Install the supporting angle steel.

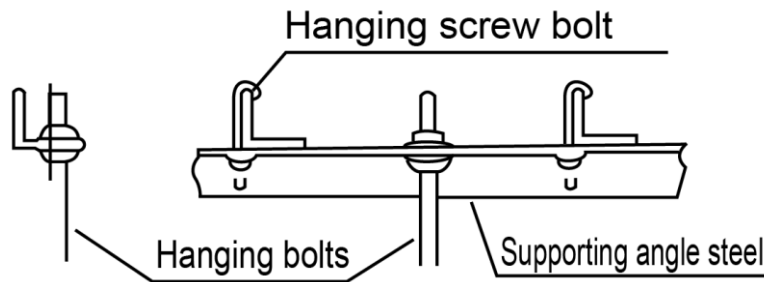

Hoisting the indoor unit


- Adjust the height of screw 2, to make the difference between the upper surface of gasket 2 and the lower surface of the ceiling is 70mm;
- Hoisting the unit on the suspender bolt as the follow figure display, use the level gauge to level-out the length and width directions, and it needs to repeatedly adjust four screw 2 of the suspender during the process. It might occur this situation: under making sure the unit level, the difference of four gasket 2 of the hoisting bolt and the lower surface of the ceiling will be discorded, can't be 70mm. At this time it should make sure the level of the unit body, and move the whole unit up and down, and make the four differences try to be close to 70mm;
- Finish adjusting the unit height and the level, fasten the screw 1 of the four suspenders, and make the unit fixed reliably.

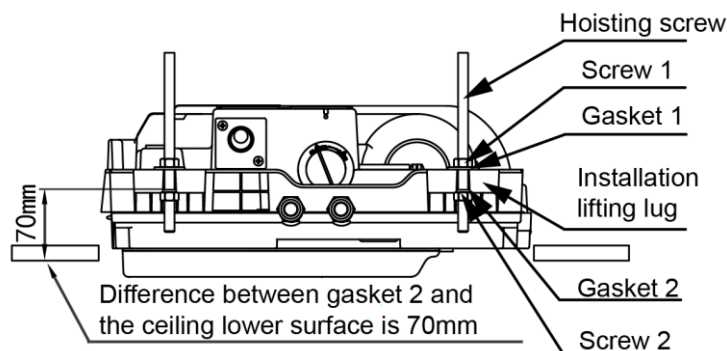

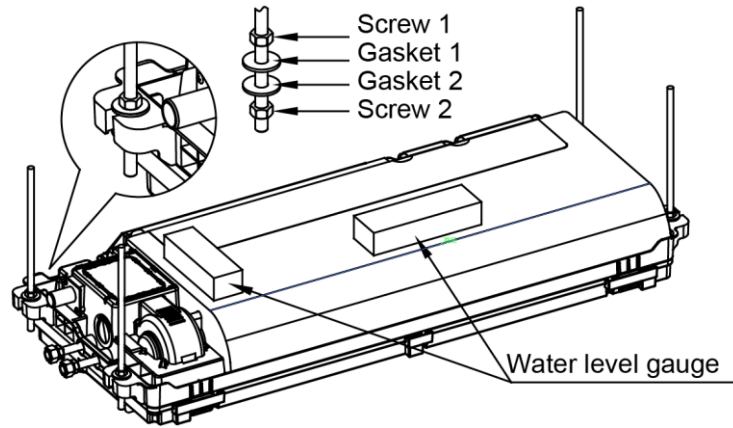


Cutting the ceiling

- Fold the installation paper plate.
- **Caution:** Folding direction is bulged out from the no printing content side;
- Use the panel fixing screws to fix the installation paper plate under the indoor unit;
- Make the ceiling opening size be the same with the outboard size of the model paper;
- Make sure the difference between the lower sides of the ceiling and model paper plate to be about 24mm, if not fit the requirements then means the hoisting height has problem;
- Please back to the above steps to re-adjust.

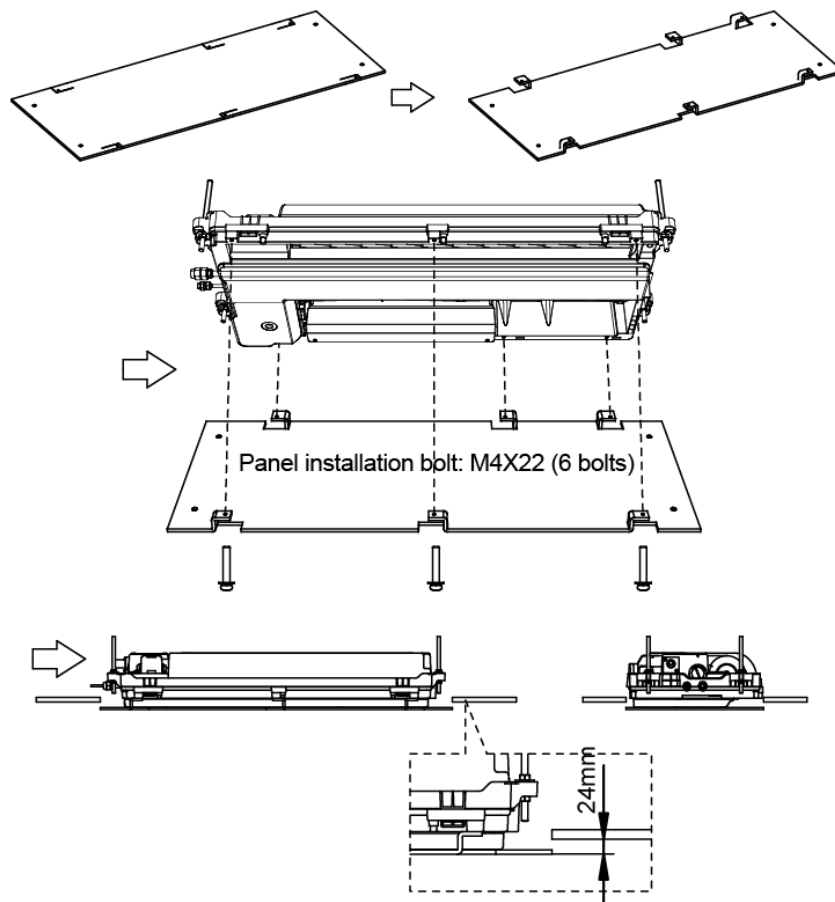



Panel component installation

- Remove the air return grille, filter screen, screw hidden cover.
- As the grille switch arrow indication direction to pull the lock catch, remove the air return grille.
- Pull the buckle as figure display, remove the filter screen.
- Open the air leading bar, remove three screw hidden covers.
- Take down the air return grille, filter screen, screw hidden cover and please safely keep them, do not lose, dirt and damage them.

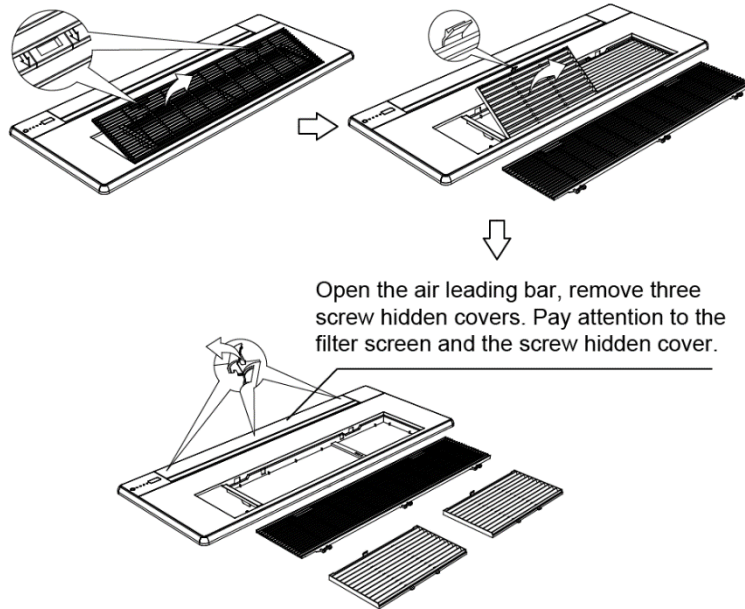


Install the panel component and wiring

- Two buckles on the panel component are used for assisting the panel installation, the installing method of the buckle as the follow figure display.
- Panel component wiring: open the electric control panel, connect the wiring terminal of the control display box and the motor connecting terminal of the air leading bar as the figure display to the main control panel.

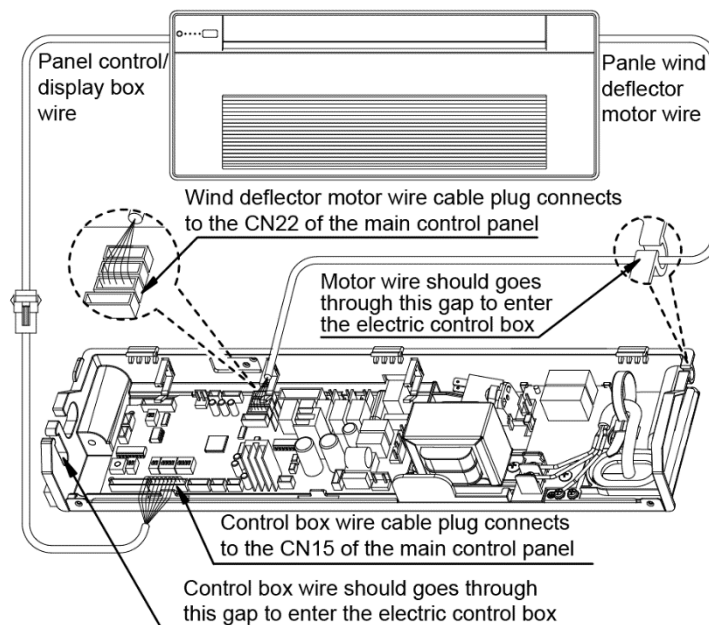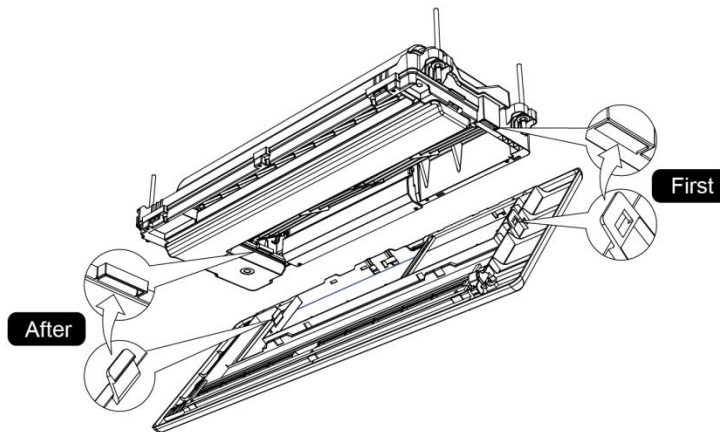


Install the screw


- Before installation please check the connecting cable between panel and air conditioner whether has clamped, if clamped, the panel will be unfairness after fastening the screws and damage the wires.

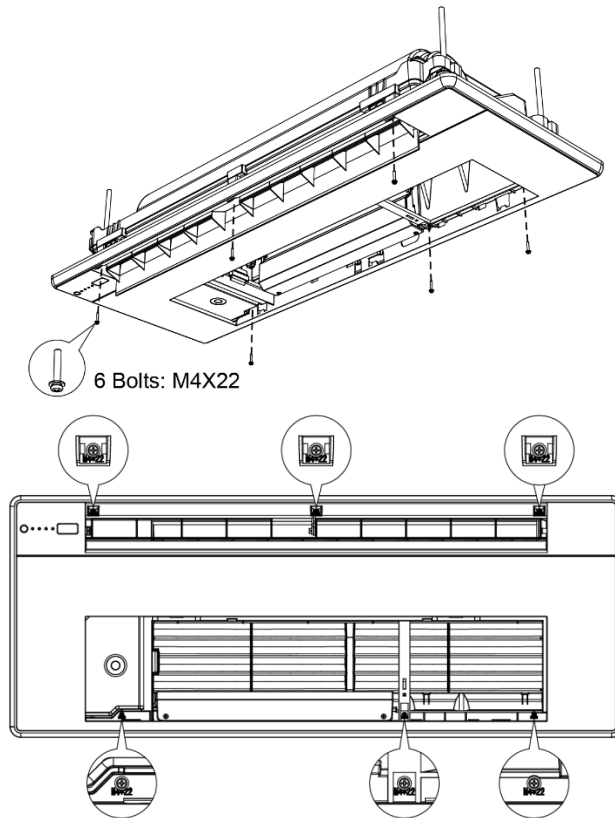

Install the screw hidden cover

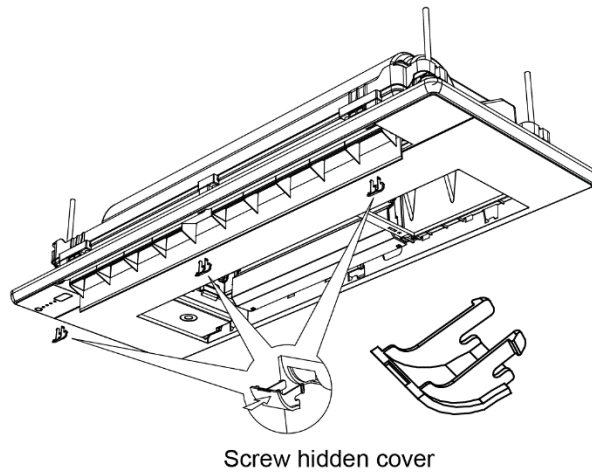

Install back the filter screen and the air return grille

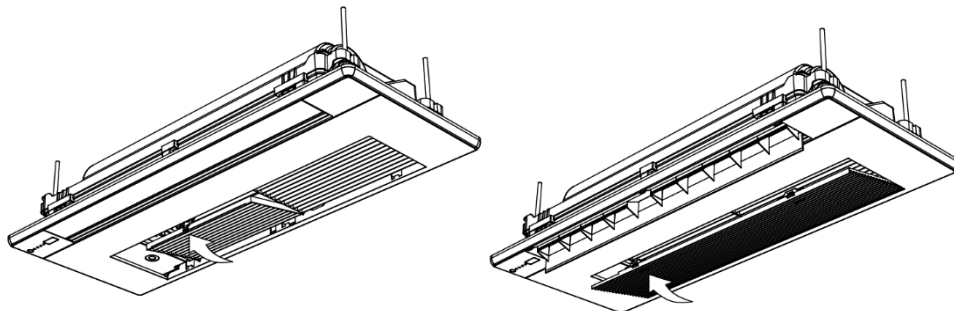

- Panel component wiring must accord to the figure display, otherwise will cause the abnormal operation. Connecting wire installation must follow the figure display, otherwise will cause the electric control box cover can't close, if there are wire clamped will cause air leakage and condensation of the panel and

so on.


- Display part of the panel should be installed at the pipe side of the unit body.
- There are 6 panel installation screws, after confirmation then to be fastened.

10.3 Drainpipe installation


- When connecting the pipe, please use the sealing material and pipe glove.
- The drain pipe of indoor unit must be heat insulated, or it will condense dew, as well as the connections of the indoor unit.
- Make sure the connections are no leakage.
- With the connection part to the indoor unit, please note not to impose pressure on the side of indoor unit pipes.
- When the declivity of the drain pipe downwards is over 1/100, there should not be any winding.
- The total length of the drain pipe when pulled out breadthwise shall not exceed 20m. When the pipe is over long, a bracket must be installed to prevent winding.
- Refer to the following figures to install the pipes.

Drainage system type

Centralized drainage of several air conditioners

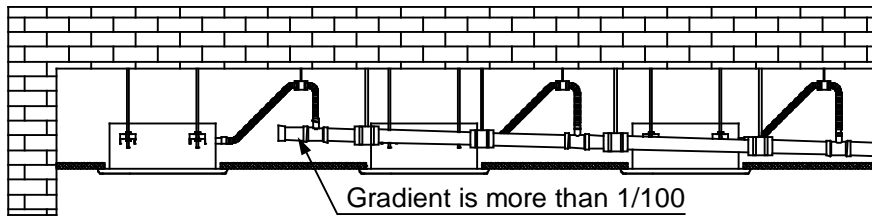


Single air conditioner drainage

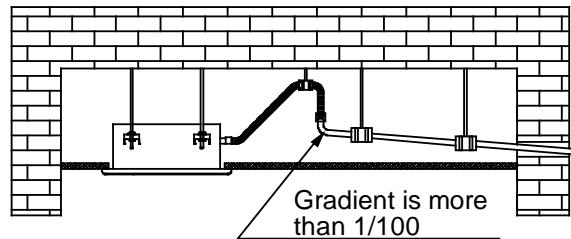


Drainage system design requirement

- Between climbing section length(L) and pipe inner diameter(d) should satisfy the relation: $L \times d^2 \leq 650000$ (unit: mm). That is water in the climbing section can't more than 500 mL, otherwise will cause poor drainage, flowing water leakage problems.
- It must accord to the requirement to install the water pipe. Suggest using water pipe with the inner diameter 25mm, and the climbing length is not over than 1m.

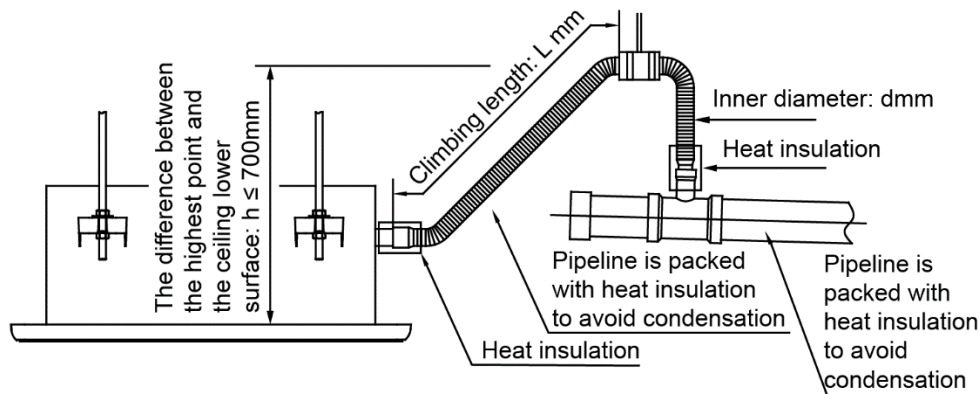

- Please according to the tube hardness to choose proper support density, do not appear obvious dropping and deformation situation. Dropping part will save the water and lead to poor drainage and


abnormal noise.

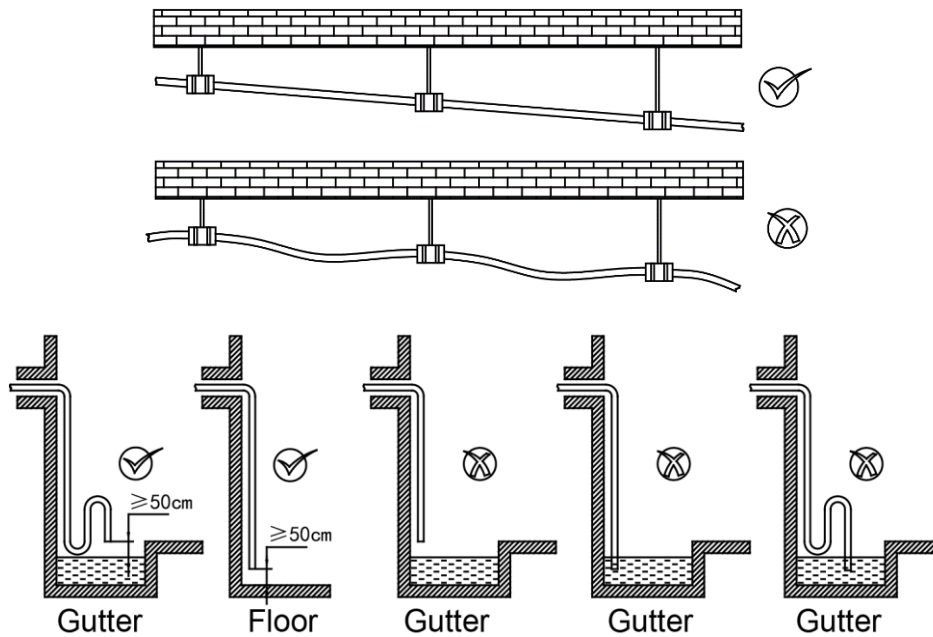

- Drainage pipe can use PVC pipe.
- The user can purchase the pipe of suitable length in the dealer place or in a local after-sale service center place, or directly to purchase in the market.
- Insert the drainage pipe port to the condensate water outlet, and use the outlet clamp (accessory) to fasten the drainage pipe and the thermal insulation sleeve.
- The pipes are needed to be packed with insulation heat preservation material. The connection of water pipe and air conditioner should use insulating sheath package, and tighten tightly to prevent water condensation to damage the ceiling decoration.
- To avoid water poured into the air conditioner inside when the unit operation stops, drainage pipe should be down dipped to outdoor side (drainage side), gradient is more than 1/100, drainage pipeline can't occur bending and dropping save water phenomenon, otherwise it will cause abnormal noise.
- During connecting pipe, please do not force pulling the drainage pipe which will cause the nozzle loose, and at the same time shall set up enough strong points, in order to avoid the drainage pipe drops.


Drainage test

- After the unit installation then do the trial run and water drainage test. Power on the indoor and outdoor unit; operate the cooling mode and do the water drainage test.
- Open the cover of water test hole, use bottle or flexible pipe to fill water (500ml/min.), and then to observe whether has water drain out from the water drainage port. Check whether the pipeline has leakage and places which not pack with thermal material, and improve the parts with problems.
- After finishing water drainage and power off the unit, install back the cover of water test hole.

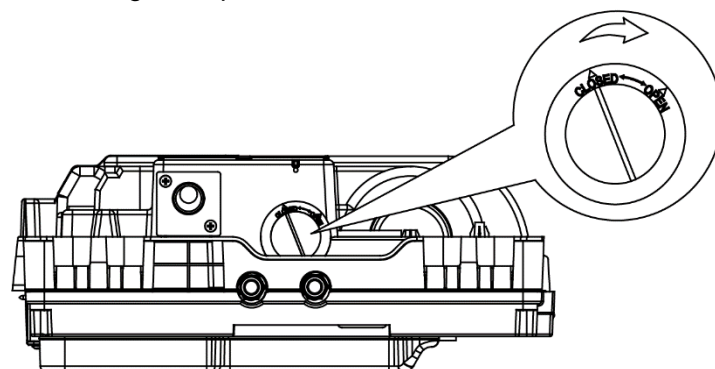


10.4 Install the connection pipe

Connecting pipes

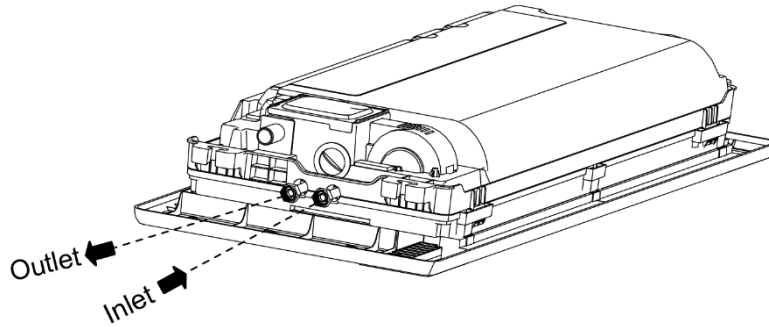


- Before connecting the pipes, make sure the seal washers located inside the connecting nut.
- Connect the unit to the water system by means of the fittings which are marked inlet and outlet.



- Avoid the damage to screw thread of evaporator, do not overexertion, when screwing. For avoid non-screw up or damage of screw thread, two spanners must be used simultaneously.
- Lag the connection pipes and any valves with anti-condensation material 10 mm thick or install the auxiliary.
- Ensure all interfaces not water leakage.

Air Exhaust

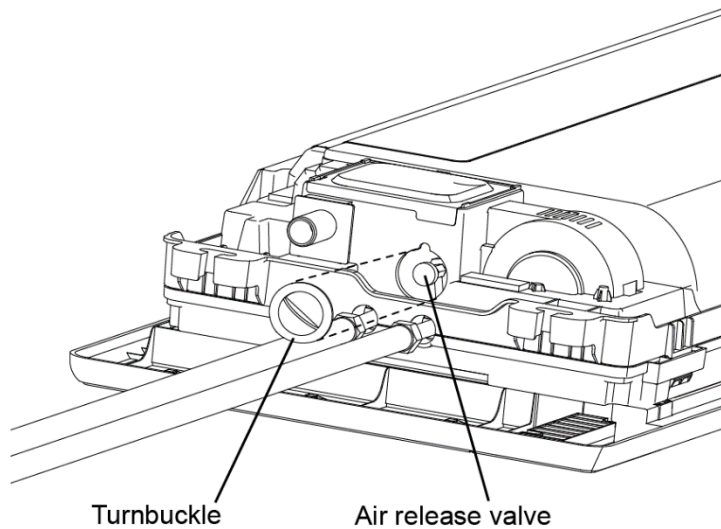

- When finished pipes and junctions connection. Turn the turnbuckle down, find the air release valve inside the unit, and exhaust the air contained in the circuit.

11. Troubleshooting

11.1 Troubles and causes of air conditioner

Symptoms	Causes	Solution
Unit does not start	<ul style="list-style-type: none"> Power failure. Power switch is off. Fuse of power switch may have burned. Batteries of remote controller exhausted or other problem of controller. 	<ul style="list-style-type: none"> Wait for the comeback of power. Switch on the power. Replace the fuse. Replace the batteries or check the controller.
Air flowing normally but completely can't cooling	<ul style="list-style-type: none"> Temperature is not setted correctly. 	<ul style="list-style-type: none"> Set the temperature properly.
Units start or stop frequently	<ul style="list-style-type: none"> Air or no concreting gas in the watering circuit. three-way valve is malfunction. Voltage is too high or too low. System circuit is blocked. Temperature is not setted correctly. 	<ul style="list-style-type: none"> Vacuum . Maintenance or change three-way valve. Install manostat. Find reasons and solution.
Low cooling effect	<ul style="list-style-type: none"> Indoor unit heat exchanger is dirty. The air filter is dirty. Inlet/outlet of indoor units is blocked. Doors and windows are open Sunlight directly shine. Too much heat resource. Leakage of water . 	<ul style="list-style-type: none"> Clean the heat exchanger. Clean the air filter. Eliminate all dirties and make air smooth. Close doors and windows. Make curtains in order to shelter from sunshine. Reduce heat source. AC cooling capacity reduces (normal). Check leakage .
Low heating effect	<ul style="list-style-type: none"> Doors and windows not completely closed. Leakage of water. 	<ul style="list-style-type: none"> Use heating device. Close doors and windows. Check leakage.

11.2 Troubles and causes of remote controller

Symptoms	Causes	Solution
The fan speed can not be changed.	<ul style="list-style-type: none"> ● Check whether the MODE indicated on the display is "AUTO" 	When the automatic mode is selected, the air conditioner will automatically change the fan speed.
	<ul style="list-style-type: none"> ● Check whether the MODE indicated on the display is "DRY" 	When dry operation is selected, the air conditioner automatically change the fan speed. The fan speed can be selected during "COOL", "FAN ONLY", and "HEAT"
The remote controller signal is not transmitted even when the ON/OFF button is pushed.	<ul style="list-style-type: none"> ● Check whether the batteries in the remote controller are exhausted. 	The power supply is off.
The TEMP. indicator does not come on.	<ul style="list-style-type: none"> ● Check whether the MODE indicated on the display is FAN ONLY 	The temperature cannot be set during FAN mode.
The indication on the display disappears after a lapse of time.	<ul style="list-style-type: none"> ● Check whether the timer operation has come to an end when the TIMER OFF is indicated on the display. 	The air conditioner operation will stop up to the set time
The TIMER ON indicator goes off after a lapse of certain time.	<ul style="list-style-type: none"> ● Check whether the timer operation is started when the TIMER ON is indicated on the display. 	Up to the set time, the air conditioner will automatically start and the appropriate indicator will go off.
No receiving tone sounds from the indoor unit even when the ON/OFF button is pressed.	<ul style="list-style-type: none"> ● Check whether the signal transmitter of the remote controller is properly directed to the infrared signal receiver of the indoor unit when the ON/OFF button is pressed. 	Directly transmit the signal transmitter of the remote controller to the infrared signal receiver of the indoor unit, and then repeatedly push the ON/OFF button twice.

11.3 Malfunctions and malfunction code

If anything happens like the situation described below, please shut off the power supply of the unit and contact with the customer service center immediately.

NO.	Malfunction	running lamp	timer lamp	defrosting lamp	alarm lamp	alarm lamp
1	Room temperature sensor checking channel is abnormal	×	☆	×	×	E2
2	Evaporator sensor checking channel is abnormal	☆	×	×	×	E3/E4
3	EEPROM malfunction	☆	☆	×	×	E7
4	Water-level switch malfunction	×	×	×	☆	E8

(× Extinguish, ☆ Flash at 5Hz)